

**LEGENDA:**

**GRANICE**

■ ■ ■ ■ ■ granica plana

▲ POSTOJEĆA DTS 100,4 kV  
◻ PLANIRANA DTS 100,4 kV


— POSTOJEĆI VN 10 kV KABAL  
- - - POSTOJEĆI 10 kV KABAL YA UKIDANJE  
- - - NOVOPLANIRANI 10 kV KABAL

**POSTOJEĆE DTS:**

- 11 POSTOJEĆA MBTS 100,4 kV "BENZINSKA PUMPA" 2x630 kV;
- 10 POSTOJEĆA MBTS 100,4 kV "BENZINSKA PUMPA 2" 1x630 kV;

**PLANIRANE DTS:**

- 1 PLANIRANA DTS 100,4 kV 1x1000 kV (Rozino 2 - Blok 8);
- 2 PLANIRANA DTS 100,4 kV 2x630 kV (Rozino 2 - Blok 8);
- 3 PLANIRANA DTS 100,4 kV 1x1000 kV (Rozino 2 - Blok 7);
- 4 PLANIRANA DTS 100,4 kV 1x630 kV (Rozino 2 - Blok 6);
- 5 PLANIRANA DTS 100,4 kV 1x630 kV (Rozino 2 - Blok 5);
- 6 PLANIRANA DTS 100,4 kV 2x1000 kV (Rozino 2 - Blok 2);
- 7 PLANIRANA DTS 100,4 kV 1x630 kV (Rozino 2 - Blok 1);
- 8 PLANIRANA DTS 100,4 kV 2x630 kV (Rozino 2 - Blok 3);
- 9 PLANIRANA DTS 100,4 kV 1x630 kV (Rozino 2 - Blok 5);
- 12 PLANIRANA DTS 100,4 kV 1x630 kV (Rozino 2 - Blok 4);

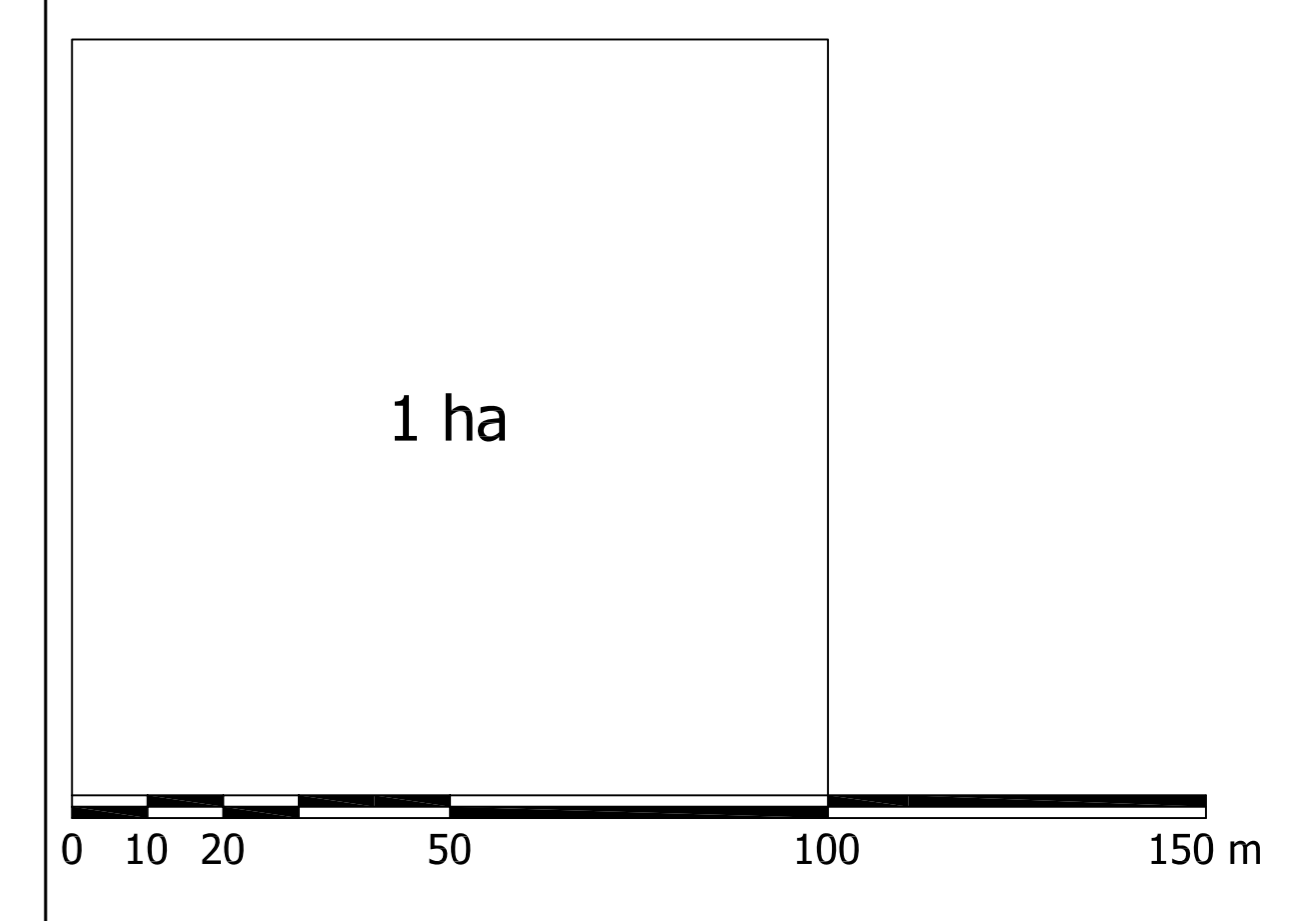

list 15.

**PLANIRANO STANJE  
ELEKTROENERGETSKA  
MREZA**

**R 1:1000**