


ŠEMA BLOKOVA



LEGENDA:



- granica plana
- POSTOJEĆI VN 10 KV KABAL ČIJA SE FUNKCIJA ZADRŽAVA
- NOVI 10 KV KABAL (zamjena dijela trase postojećeg kabla)
- NOVOPLANIRANI 10 KV KABAL
- POSTOJEĆI VN 10 KV KABAL KOJI SE STAVLJA VAN FUNKCIJE
- POSTOJEĆA DTS 10/0,4 KV
- PLANIRANA DTS 10/0,4 KV

POSTOJEĆE DTS:

- 16 POSTOJEĆA MBTS: 10/0,4 KV "TRAP" 1x400 KV;

PLANIRANE DTS:

- 1 PLANIRANA DTS 10/0,4 KV 2x630 KV (Blok 1);
- 2 PLANIRANA DTS 10/0,4 KV 1x1.000 KV (Blok 1);
- 3 PLANIRANA DTS 10/0,4 KV 1x1.000 KV (Blok 2);
- 4 PLANIRANA DTS 10/0,4 KV 1x1.000 KV (Blok 2);
- 5 PLANIRANA DTS 10/0,4 KV 2x630 KV (Blok 4);
- 6 PLANIRANA DTS 10/0,4 KV 1x630 KV (Blok 8);
- 7 PLANIRANA DTS 10/0,4 KV 1x1.000 KV (Blok 9);
- 8 PLANIRANA DTS 10/0,4 KV 1x1.000 KV (Blok 11);
- 9 PLANIRANA DTS 10/0,4 KV 1x1.000 KV (Blok 11);
- 10 PLANIRANA DTS 10/0,4 KV 1x630 KV (Blok 13);
- 11 PLANIRANA DTS 10/0,4 KV 1x630 KV (Blok 12);
- 12 PLANIRANA DTS 10/0,4 KV 1x630 KV (Blok 16);
- 13 PLANIRANA DTS 10/0,4 KV 1x630 KV (Blok 17);
- 14 PLANIRANA DTS 10/0,4 KV 1x630 KV (Blok 17);
- 15 PLANIRANA DTS 10/0,4 KV 1x1.000 KV (Blok 15);
- 17 PLANIRANA DTS 10/0,4 KV 1x630 KV (Blok 19);
- 18 PLANIRANA DTS 10/0,4 KV 1x630 KV (Blok 22);
- 19 PLANIRANA DTS 10/0,4 KV 1x630 KV (Blok 22);
- 20 PLANIRANA DTS 10/0,4 KV 1x1.000 KV (Blok 22);
- 21 PLANIRANA DTS 10/0,4 KV 1x1.000 KV (Blok 22);

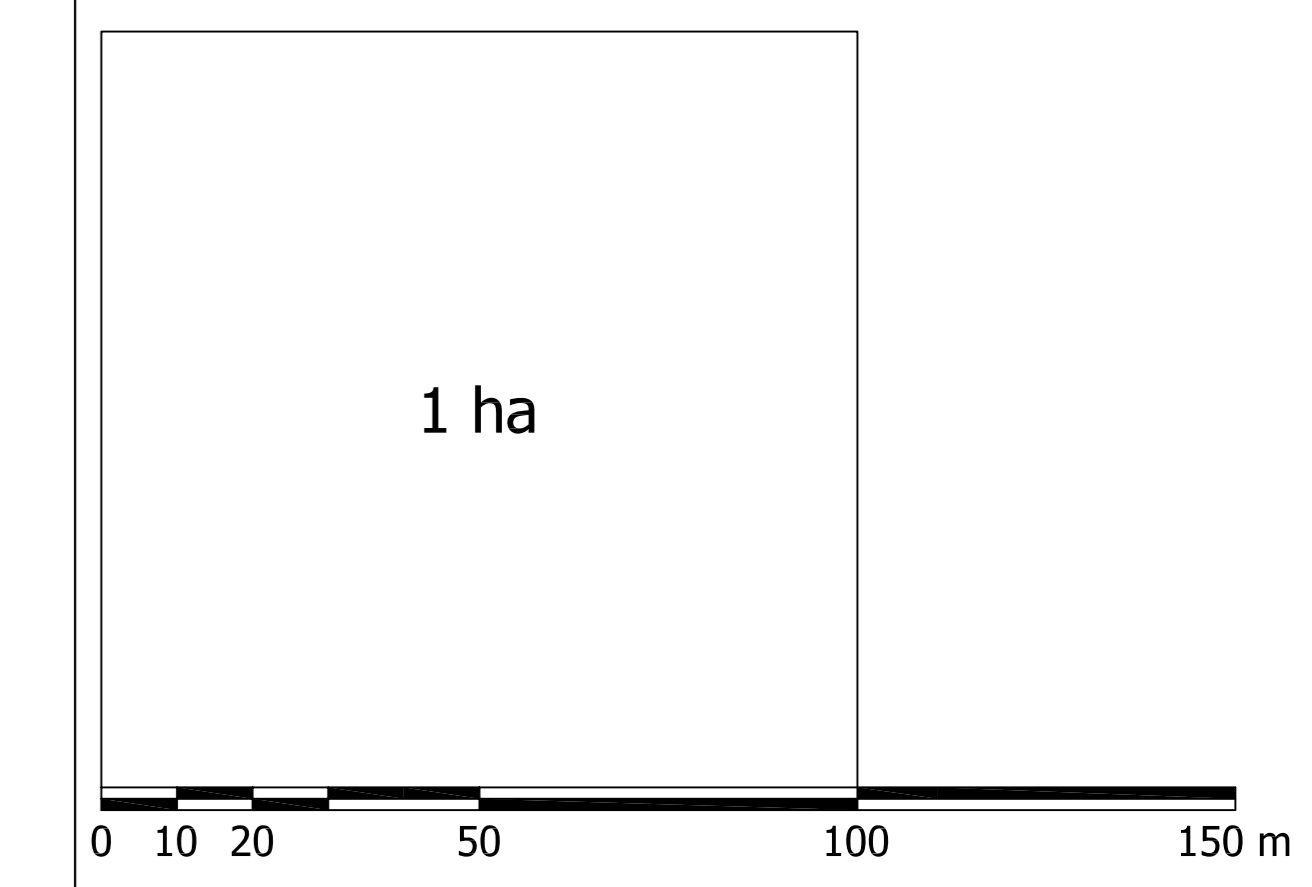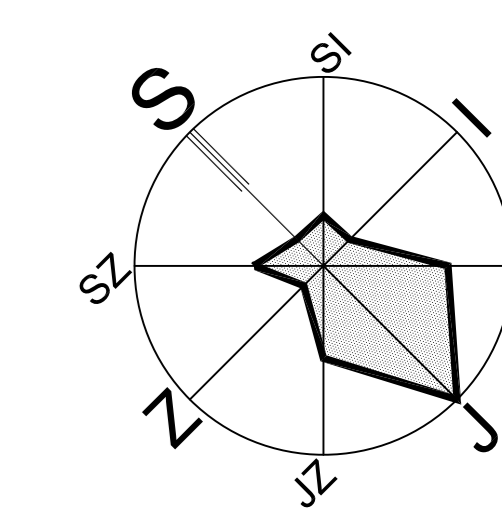

list 16.

**PLANIRANO STANJE
ELEKTROENERGETSKA
MREŽA
R 1:1000**

NARUČILAC
 OBRADIVAC